

FIGURE I.1(c) Underground ASME Containers. (This figure for illustrative purposes only; code shall govern.)

Annex J Sample Ordinance Adopting NFPA 58

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

J.1 The following sample ordinance is provided to assist a jurisdiction in the adoption of this code and is not part of this code.

ORDINANCE NO. _____

An ordinance of the [jurisdiction] adopting the 2008 edition of NFPA 58, *Liquefied Petroleum Gas Code*, documents listed in Chapter 2 of that code; prescribing regulations governing conditions hazardous to life and property from fire or explosion; providing for the issuance of permits and collection of fees; repealing Ordinance No. _____ of the [jurisdiction] and all other ordinances and parts of ordinances in conflict therewith; providing a penalty; providing a severability clause; and providing for publication; and providing an effective date.

BE IT ORDAINED BY THE [governing body] OF THE [jurisdiction]:

SECTION 1 That the *Liquefied Petroleum Gas Code* and documents adopted by Chapter 2, three (3) copies of which are on file and are open to inspection by the public in the office of the [jurisdiction's keeper of records] of the [jurisdiction], are hereby adopted and incorporated into this ordinance as fully as if set out at length herein, and from the date on which this ordinance shall take effect, the provisions thereof shall be con-

trolling within the limits of the [jurisdiction]. The same are hereby adopted as the code of the [jurisdiction] for the purpose of prescribing regulations governing conditions hazardous to life and property from fire or explosion and providing for issuance of permits and collection of fees.

SECTION 2 Any person who shall violate any provision of this code or standard hereby adopted or fail to comply therewith; or who shall violate or fail to comply with any order made thereunder; or who shall build in violation of any detailed statement of specifications or plans submitted and approved thereunder; or failed to operate in accordance with any certificate or permit issued thereunder; and from which no appeal has been taken; or who shall fail to comply with such an order as affirmed or modified by or by a court of competent jurisdiction, within the time fixed herein, shall severally for each and every such violation and noncompliance, respectively, be guilty of a misdemeanor, punishable by a fine of not less than \$ _____ nor more than \$ _____ or by imprisonment for not less than _____ days nor more than _____ days or by both such fine and imprisonment. The imposition of one penalty for any violation shall not excuse the violation or permit it to continue; and all such persons shall be required to correct or remedy such violations or defects within a reasonable time; and when not otherwise specified the application of the above penalty shall not be held to prevent the enforced removal of prohibited conditions. Each day that prohibited conditions are maintained shall constitute a separate offense.

1. Underground LP Gas systems must be designed and installed in accordance with the provisions of NFPA 58, Standard For The Storage and Handling of Liquefied Gases; NFPA 54, National Fuel Gas Code; BOCA, National Fire Prevention Code, and all applicable state, provincial, and local codes and regulations covering these installations, specifically including RSA 146-C.

2. An underground tank shall be set on a firm foundation; i.e., poured concrete pad. All tanks must be anchored to the concrete foundation using appropriate methods; i.e., plastic covering wrapped around tie downs.

3. Clean sand (no rocks) shall be used to back fill around the tank and gas lines to the building foundation.

4. Marking tape shall be installed below ground level, approximately one foot ~~below~~ above buried gas lines, for warning purposes.

5. A manual shut-off shall be installed on gas lines, to be located at the side of the building nearest the location of the buried gas tank. - Line of sight from tank fill to Regulator!

6. Two (2) anode bags shall be installed with any buried tank over 500 gallons; one anode bag with any buried tank of 500 gallons or less. (Anode bags shall be spot welded to tank, and located at the lowest point in tank hole.)

7. Each tank installation will be marked with a three-foot column above grade, placed close to the center of the buried tank and painted yellow. This column shall be permanent in nature and have a minimum diameter of one inch (1").

Recommended by the Board of Selectmen


SEE BELOW FOR MINIMUM SPECS FOR CONCRETE PAD

Pour 12' x 5' concrete pad for both 325 GAL + 500 GAL TANKS

Pour 20' x 5' concrete pad for 1000 GAL TANK

EACH POUR WILL BE AT LEAST 6" THICK - REINFORCED

INSTALL four (4) Tie Downs on each pad.

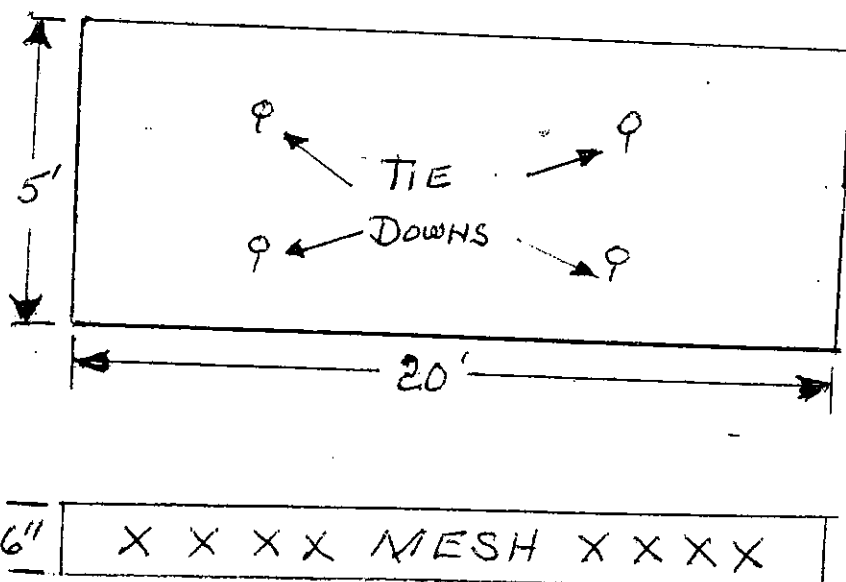

THERE WILL BE ONE INSPECTION at 30' EACH.